



21 February 2020

Our Ref: DA3593
MSLink108157

Gideon Town Planning
PO Box 450
ROCKHAMPTON QLD 4700

Cc. Rockhampton Regional Council
PO Box 1860
ROCKHAMPTON QLD 4700

Via Email: info@gideontownplanning.com.au

enquiries@rrc.qld.gov.au

Attention: Rebecca Harney
Reference:

Kathy McDonald
D/17-2020

Dear Sir/Madam

Referral Agency Response (Advice)

(Given under section 9.2 of the Development Assessment Rules)

Transmission Infrastructure Impacted	
Transmission Corridor	Callide A Rockhampton
Easement ID	Easement B on RP610537 – Dealing No 602671462
Location Details	
Street address	75 Reaney Street, Rockhampton
Real property description	Lot 186 on LN1397
Local government area	Rockhampton Regional Council
Application Details	
Proposed development:	Material Change of Use –Outdoor Sport and Recreation
Approval sought	Development Permit

We refer to the above referenced development application which has been referred to Powerlink Queensland in accordance with Section 54 of the *Planning Act 2016*.

In accordance with its jurisdiction under Schedule 10 Part 9 Division 2 of the *Planning Regulation 2017*, Powerlink Queensland is a **Referral Agency (Advice)** for the above development application.

Specifically, the application has been triggered for assessment by Powerlink Queensland because:

1. For **material change of use** – all or part of the premises are subject to a transmission entity easement which is part of the transmission supply network (Table 2 1b)

33 Harold Street, Virginia
PO Box 1193, Virginia, Queensland 4014, Australia
Telephone: (07) 3860 2111 Facsimile: (07) 3860 2100
www.powerlink.com.au

Powerlink Queensland is the registered business name of the
Queensland Electricity Transmission Corporation Limited
ABN 82 078 849 233

PLANS AND REPORTS ASSESSED

The following plans and reports have been reviewed by Powerlink Queensland and form the basis of our assessment. Any variation to these plans and reports may require amendment of our advice.

Table 1: Plans and Reports upon which the assessment is based

Drawing / Report Title	Prepared by	Dated	Reference No.	Version / Issue
Planning Report	Gideon Town Planning	February 2020		
Site Plan	Design & Architecture Pty Ltd	Jan 20	SK-001 GG-036	1

Powerlink Queensland, acting as a Referral Agency (Advice) under the Planning Regulation 2017 provides its response to the application as attached (**Attachment 1**).

For further information please contact Frances Jennings, Property Services Advisor, on (07) 3866 1313 or via email property@powerlink.com.au who will be pleased to assist.

Yours sincerely



Brandon Kingwill
MANAGER PROPERTY

ATTACHMENT 1 – REFERRAL AGENCY (ADVICE) RESPONSE

Powerlink Queensland **supports** this application subject to the inclusion of the following conditions in the Assessment Manager's Decision Notice.

No.	Condition	Timing	Reason
1	The development must be carried out generally in accordance with the reviewed plans detailed in Table 1.	At all times	To ensure that the development is carried out generally in accordance with the plans of development submitted with the application.
2	The statutory clearances set the Electrical Safety Regulation 2013 must be maintained during construction and operation. No encroachment within the statutory clearances is permitted.	At all times	To ensure that the purpose of the Electrical Safety Act 2002 is achieved and electrical safety requirements are met.
3	Compliance with the terms and conditions of the easement dealing no shown in the heading of this letter.	At all times	To ensure that the existing rights contained in the registered easement dealing is maintained.
4	Compliance with the generic requirements in respect to proposed works in the vicinity of Powerlink Queensland infrastructure as detailed in the enclosed Annexure "A".	At all times	To ensure that the purpose of the Electrical Safety Act 2002 is achieved and electrical safety requirements are met. To ensure the integrity of the easement is maintained.

Advice to Council and the Applicant

1. This response does not constitute an approval to commence operational works within the transmission line corridor.

Please note that a separate application will need to be submitted for any proposed works within the power line corridor (or that have the potential to impact upon the corridor) - including but not limited to service provision and stormwater and/or drainage works. This separate application would require the submission to Powerlink of detailed engineering drawings for assessment and consent (or otherwise). Further, Powerlink may require that such drawings be provided in electronic format (3D DXF or equivalent of final design RL's AHD and MGA GDA94 in applicable zone).


Please allow approximately 6 weeks for the assessment of engineering plans etc. for any proposed on easement works

2. We draw your attention to the obligations and requirements of the Electrical Safety Act 2002 ("the Act") including any Code of Practice under the Act and the Electrical Safety Regulation 2013 ("the Regulation") including any safety exclusion zones defined in the Regulation.

In respect to this application the exclusion zone for untrained persons and for operating plant operated by untrained persons is **three (3) metres** from the **132,000-volt** wires and exposed electrical parts.

Should any doubt exist in maintaining the prescribed clearance to the conductors and electrical infrastructure, then the applicant is obliged under the Act to seek advice from Powerlink Queensland.

ATTACHMENT 2 – PLAN

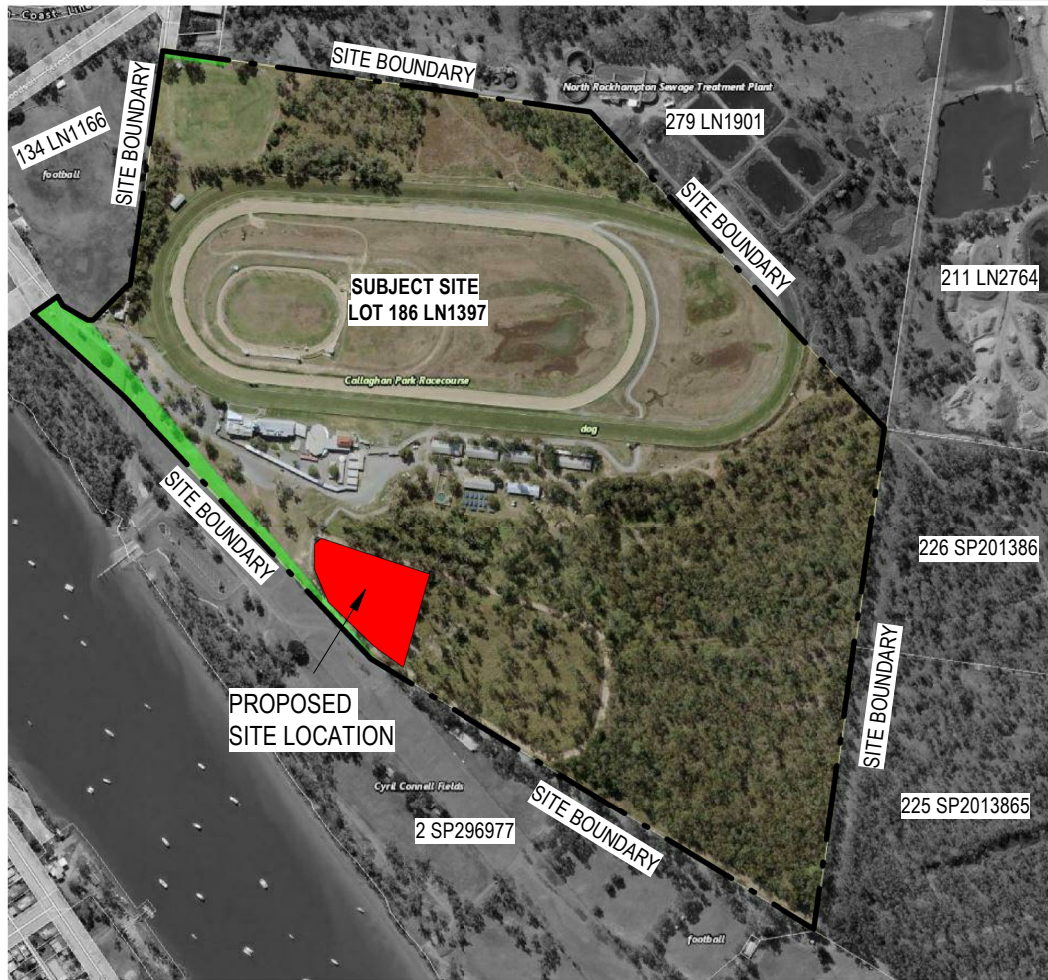

2 LOCATION PLAN
1: 10000 @ A3

GENERAL NOTE:

- THESE DRAWINGS ARE PART OF A TOWN PLANNING APPROVAL APPLICATION AND SHOULD NOT BE USED FOR ANY OTHER REASON
- THESE DRAWINGS ARE APPROXIMATE AND HIGHLY CONCEPTUAL
- TRAFFIC/STORMWATER/OPERATIONAL WORKS: AS PER CIVIL ENGINEER DOCUMENTS AND DRAWINGS IF REQUIRED
- CURRENT LOCATIONS AND BOUNDARY LINE ARE APPROXIMATE, RELEVANT SURVEY TO BE CONDUCTED BEFORE ANY DOCUMENTATION OR CONSTRUCTION
- REFER TO TOWNPLANNING APPLICATION AND OPERATIONAL WORKS DOCUMENTATION WHEN VIEWING THESE PLANS
- THESE DRAWINGS ARE CONCEPTUAL AND DO NOT REFLECT BUILDING APPROVAL, PLUMBING APPROVAL, QFRS APPROVAL OR DISABILITY REQUIREMENTS. CLIENT TO CONFIRM AND GET APPROVAL FROM RELEVANT AUTHORITIES

NOTE:

ALL BOUNDARIES AND LOCATIONS ARE APPROXIMATES

SUBJECT SITE AREA: 722853 m²

PROPOSED SITE LOCATION AREA: 14318 m²

1 SITE PLAN
1: 1000 @ A3


A3 DRAWING NOTED SCALES RELATE TO A3 DRAWINGS

drawing no:

SK-001

project no:

GG-036



project:
OUTDOOR SPORT+RECREATION FACILITY
drawing title:
SITE PLAN
location:
CALLAGHAN PARK RACECOURSE, 75 REANEY STREET, THE COMMON, LOT 186 LN1397

REV	DESCRIPTION	DATE
1	PRELIMINARY	24/01/2020

PRELIMINARY SKETCH PLANS:
If the drawings are labelled and issued 'preliminary', below, they are not suitable for Building Application, tender or construction purposes! The intent of preliminary sketch plans are only for presenting the concept for the specific project to the client as nominated in the title sheet.

COPYRIGHT & LIABILITY:
These drawings, concepts and designs are copyrighted and the property of DESIGNANDARCHITECTURE and not to be used for any other reason without the consent or permission of designandarchitecture PTY.LTD. (ACN 167 978 832)

DESIGNANDARCHITECTURE accept no responsibility for the accuracy, completeness of electronically transferred documents.

NEVER SCALE OF DRAWINGS, IF IN DOUBT, ASK!



ISSUED FOR	
PRELIMINARY	
scale	As indicated
date	JAN 20
drawn	Author
rev	1

C:\Users\Public\PROJECTS\GG-036\GG-036.rvt

24/01/2020 2:15:20 PM

ATTACHMENT 3 – ANNEXURE A

ANNEXURE A – GENERIC REQUIREMENTS

The conditions contained in this Annexure have been compiled to assist persons (the applicant) intending to undertake work within the vicinity of high-voltage electrical installations and infrastructure owned or operated by Powerlink. The conditions are supplementary to the provisions of the Electrical Safety Act 2002, Electrical Safety Regulation 2013 and the Terms and Conditions of Registered Easements and other forms of Occupational Agreements hereinafter collectively referred to as the “Easement”. Where any inconsistency exists between this Annexure and the Easement, the Easement shall take precedence.

1. POWERLINK INFRASTRUCTURE

You may not do any act or thing which jeopardises the foundations, ground anchorages, supports, towers or poles, including (without limitation) inundate or place, excavate or remove any soil, sand or gravel within a distance of twenty (20) metres surrounding the base of any tower, pole, foundation, ground anchorage or support.

2. STRUCTURES

No structures should be placed within twenty (20) metres of any part of a tower or structure foundation or within 5m of the conductor shadow area. Any structures on the easement require prior written consent from Powerlink.

3. EXCLUSION ZONES

Exclusion zones for operating plant are defined in Schedule 2 of the Electrical Safety Regulation 2013 for Untrained Persons. All Powerlink infrastructure should be regarded as “electrically live” and therefore potentially dangerous at all times.

In particular your attention is drawn to Schedule 2 of the Electrical Safety Regulation 2013 which defines exclusion zones for untrained persons in charge of operating plant or equipment in the vicinity of electrical facilities. If any doubt exists in meeting the prescribed clearance distances from the conductors, the applicant is obliged under this Act to seek advice from Powerlink.

4. ACCESS AND EGRESS

Powerlink shall at all times retain the right to unobstructed access to and egress from its infrastructure. Typically, access shall be by 4WD vehicle.

5. APPROVALS (ADDITIONAL)

Powerlink's consent to the proposal does not relieve the applicant from obtaining statutory, landowner or shire/local authority approvals.

6. MACHINERY

All mechanical equipment proposed for use within the easement must not infringe the exclusion zones prescribed in Schedule 2 of the Electrical Safety Regulation 2013. All operators of machinery, plant or equipment within the easement must be made aware of the presence of live high-voltage overhead wires. It is recommended that all persons entering the Easement be advised of the presence of the conductors as part of on site workplace safety inductions. The use of warning signs is also recommended.

7. EASEMENTS

All terms and conditions of the easement are to be observed. Note that the easement takes precedence over all subsequent registered easement documents. Copies of the easement together with the plan of the Easement can be purchased from the Department of Environment & Resource Management.

8. EXPENDITURE AND COST RECOVERY

Should Powerlink incur costs as a result of the applicant's proposal, all costs shall be recovered from the applicant.

Where Powerlink expects such costs to be in excess of \$10 000.00, advanced payments may be requested.

9. EXPLOSIVES

Blasting within the vicinity (500 metres) of Powerlink infrastructure must comply with AS 2187. Proposed blasting within 100 metres of Powerlink infrastructure must be referred to Powerlink for a detailed assessment.

10. BURNING OFF OR THE LIGHTING OF FIRES

We strongly recommend that fires not be lit or permitted to burn within the transmission line corridor and in the vicinity of any electrical infrastructure placed on the land. Due to safety risks Powerlink's written approval should be sought.

11. GROUND LEVEL VARIATIONS**Overhead Conductors**

Changes in ground level must not reduce statutory ground to conductor clearance distances as prescribed by the Electrical Safety Act 2002 and the Electrical Safety Regulation 2013.

Underground Cables

Any change to the ground level above installed underground cable is not permitted without express written agreement of Powerlink.

12. VEGETATION

Vegetation planted within an easement must not exceed 3.5 metres in height when fully matured. Powerlink reserves the right to remove vegetation to ensure the safe operation of the transmission line and, where necessary, to maintain access to infrastructure.

13. INDEMNITY

Any use of the Easement by the applicant in a way which is not permitted under the easement and which is not strictly in accordance with Powerlink's prior written approval is an unauthorised use. Powerlink is not liable for personal injury or death or for property loss or damage resulting from unauthorized use. If other parties make damage claims against Powerlink as a result of unauthorized use then Powerlink reserves the right to recover those damages from the applicant.

14. INTERFERENCE

The applicant's attention is drawn to s.230 of the Electricity Act 1994 (the "Act"), which provides that a person must not wilfully, and unlawfully interfere with an electricity entity's works. "Works" are defined in s.12 (1) of the Act. The maximum penalty for breach of s.230 of the Act is a fine equal to 40 penalty units or up to 6 months imprisonment.

15. REMEDIAL ACTION

Should remedial action be necessary by Powerlink as a result of the proposal, the applicant will be liable for all costs incurred.

16. OWNERS USE OF LAND

The owner may use the easement land for any lawful purpose consistent with the terms of the registered easement; the conditions contained herein, the Electrical Safety Act 2002 and the Electrical Safety Regulation 2013.

17. ELECTRIC AND MAGNETIC FIELDS

Electric and Magnetic Fields (EMF) occur everywhere electricity is used (e.g. in homes and offices) as well as where electricity is transported (electricity networks).

Powerlink recognises that there is community interest about Electric and Magnetic Fields. We rely on expert advice on this matter from recognised health authorities in Australia and around the world. In Australia, the Federal Government agency charged with responsibility for regulation of EMFs is the Australian Radiation Protection and Nuclear Safety Agency (ARPANSA). ARPANSA's *Fact Sheet – Magnetic and Electric Fields from Power Lines*, concludes:

"On balance, the scientific evidence does not indicate that exposure to 50Hz EMF's found around the home, the office or near powerlines is a hazard to human health."

Whilst there is no scientifically proven causal link between EMF and human health, Powerlink nevertheless follows an approach of "*prudent avoidance*" in the design and siting of new powerlines. This includes seeking to locate new powerline easements away from houses, schools and other buildings, where it is practical to do so and the added cost is modest.

The level of EMF decreases rapidly with distance from the source. EMF readings at the edge of a typical Powerlink easement are generally similar to those encountered by people in their daily activities at home or at work. And in the case of most Powerlink lines, at about 100 metres from the line, the EMF level is so small that it cannot be measured.

Powerlink is a member of the ENA's EMF Committee that monitors and compiles up-to-date information about EMF on behalf of all electricity network businesses in Australia. This includes subscribing to an international monitoring service that keeps the industry informed about any new developments regarding EMF such as new research studies, literature and research reviews, publications, and conferences.

We encourage community members with an interest in EMF to visit ARPANSA's website: www.arpansa.gov.au Information on EMF is also available on the ENA's website: www.ena.asn.au